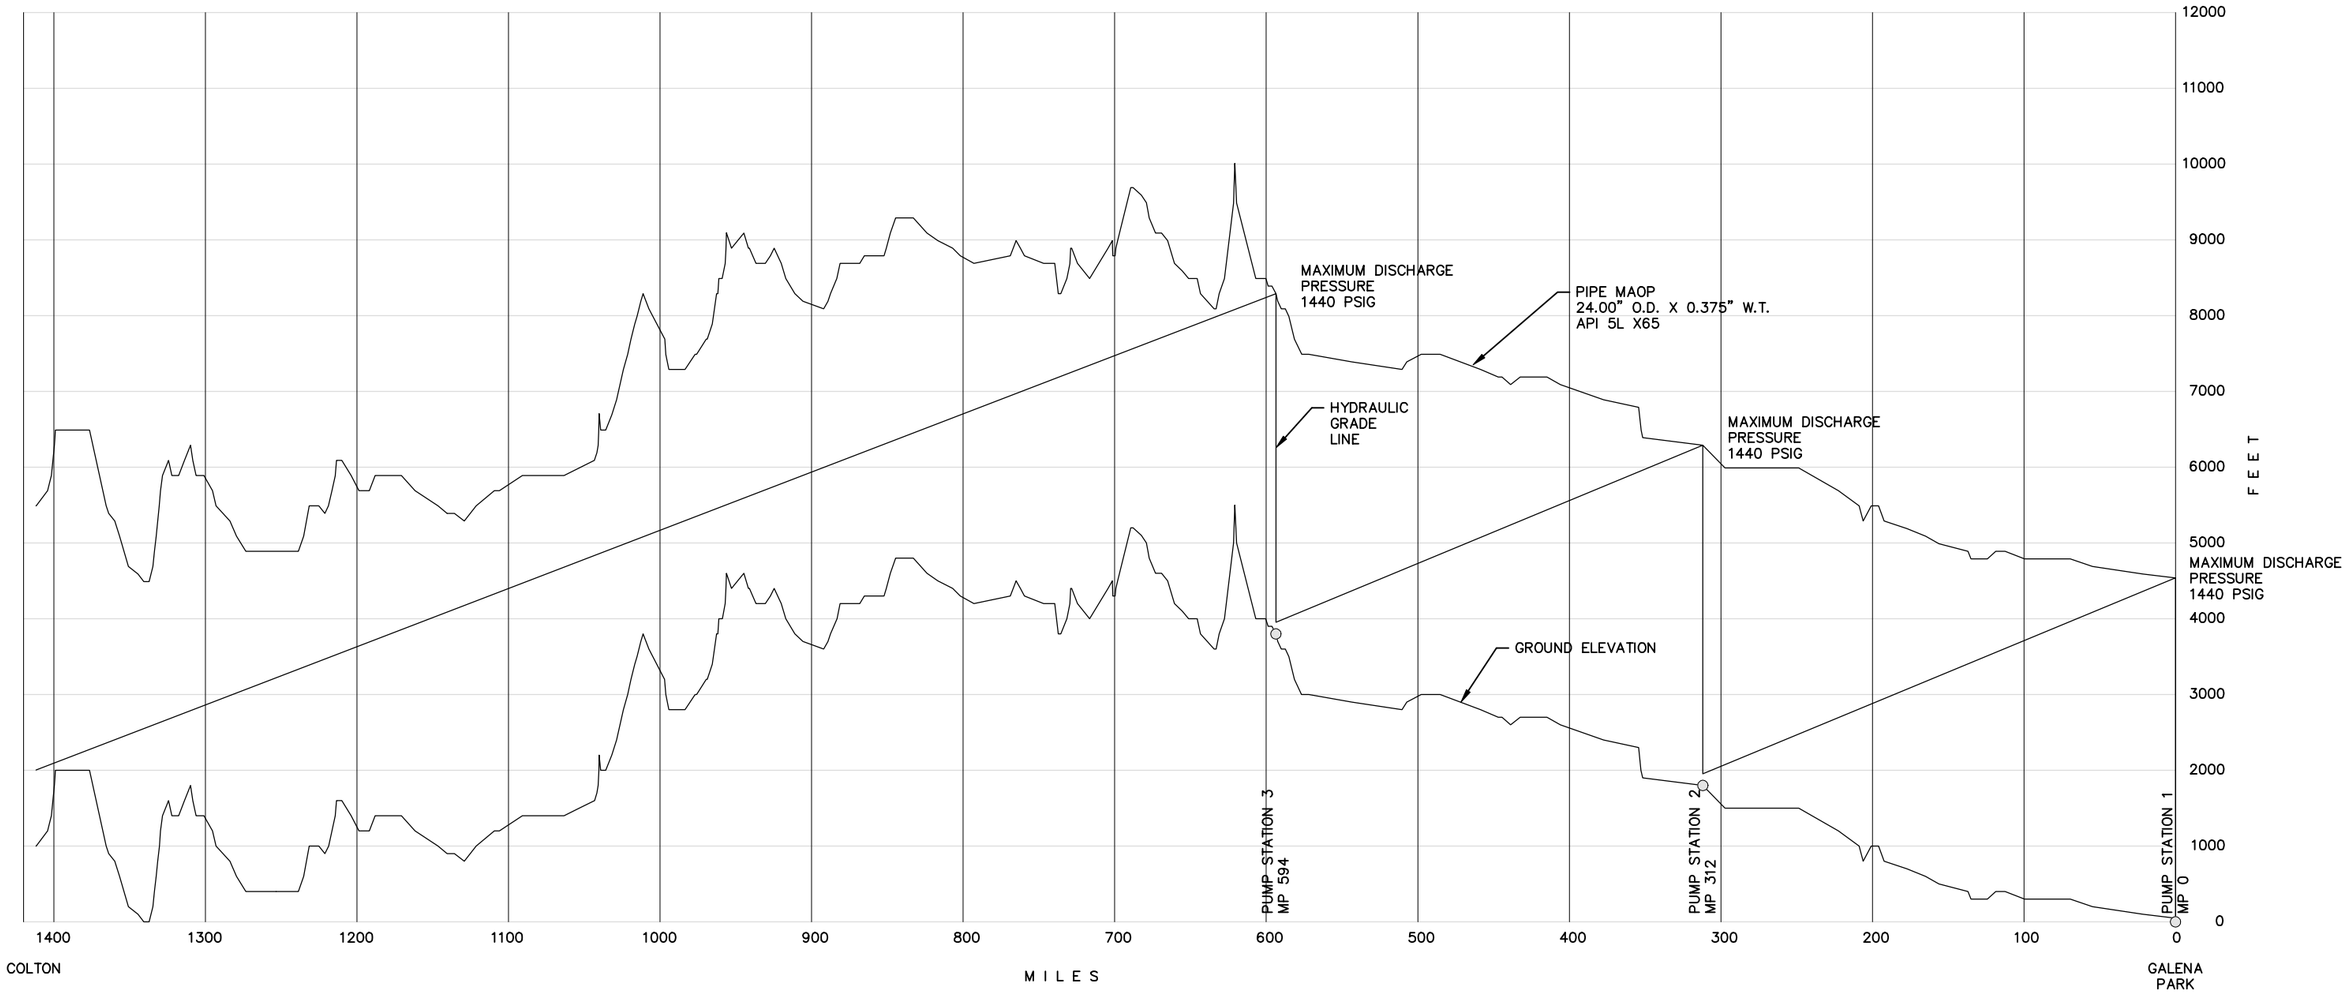

PUMP STATIONS	
○ 150,000 BPD	
PUMP STATION	MP
1	0
2	312
3	594

VALVE SPACING PER
49 CFR 195 SECTION .260

PUMP STATIONS

○ 24" / 150,000 BPD GASOLINE

1"=50 mi 50 0 50 100

REV.	REVISION	DATE
A	ISSUED FOR REVIEW	09/07/01

SPEC SERVICES

SPEC Services, Inc.
17101 Bushard Street
Fountain Valley, CA 92708
(714) 963-8077
K:\2603\2603HYP:264000

INTERLIANCE LLC CONSULTING

CONCEPTUAL PRODUCTS PIPELINE
GALENA PARK, TX TO COLTON, CA
HYDRAULIC PROFILE

DRAWN	RWS	CHECKED		DRFT. APPV.	
DATE	09/07/01	SCALE	SHOWN	ENGR. APPV.	